

One-way exit installation period
May 1 - 31

MAY

Bats are pregnant and have the ability to find a new home if required

JUNE

***No exclusions or
one-way exit
installations**

JULY

AUGUST

Bats are birthing and nursing,
baby bats cannot fly

SEPTEMBER

One-way exit installation period
September 1 - 30

Bats are mating, pups are flying and moving to winter habitats

OCTOBER

NOVEMBER

***Possible**

(under certain conditions)

DECEMBER

Avoid new one-way exits

JANUARY

Bats are mating, pups are flying,
moving to winter habitats and are hibernating

FEBRUARY

MARCH

APRIL

*** Contact the Ministry of Environment Inquiry Centre
for more information on conditions for bat exclusions.
1-800-567-4224 or by email at centre.inquiry@gov.sk.ca**

Potential winter use
by Big Brown Bats


Potential winter use
by Big Brown Bats

Exclusion Timing

POSSIBLE (under certain conditions)		NO (young cannot fly)	POSSIBLE (under certain conditions)	
AVOID NEW ONE-WAY EXITS	ONE-WAY EXIT INSTALLATION PERIOD	NO EXCLUSIONS OR ONE-WAY EXIT INSTALLATIONS	ONE-WAY EXIT INSTALLATION PERIOD	AVOID NEW ONE-WAY EXITS

Note: One-way exits need to be installed for a minimum of 5-7 nights; with at least 4 nights of low wind and sunset temperature above 10°C. See provincial guidelines for more information on conditions for bat exclusions.

SEASONAL BAT ACTIVITY

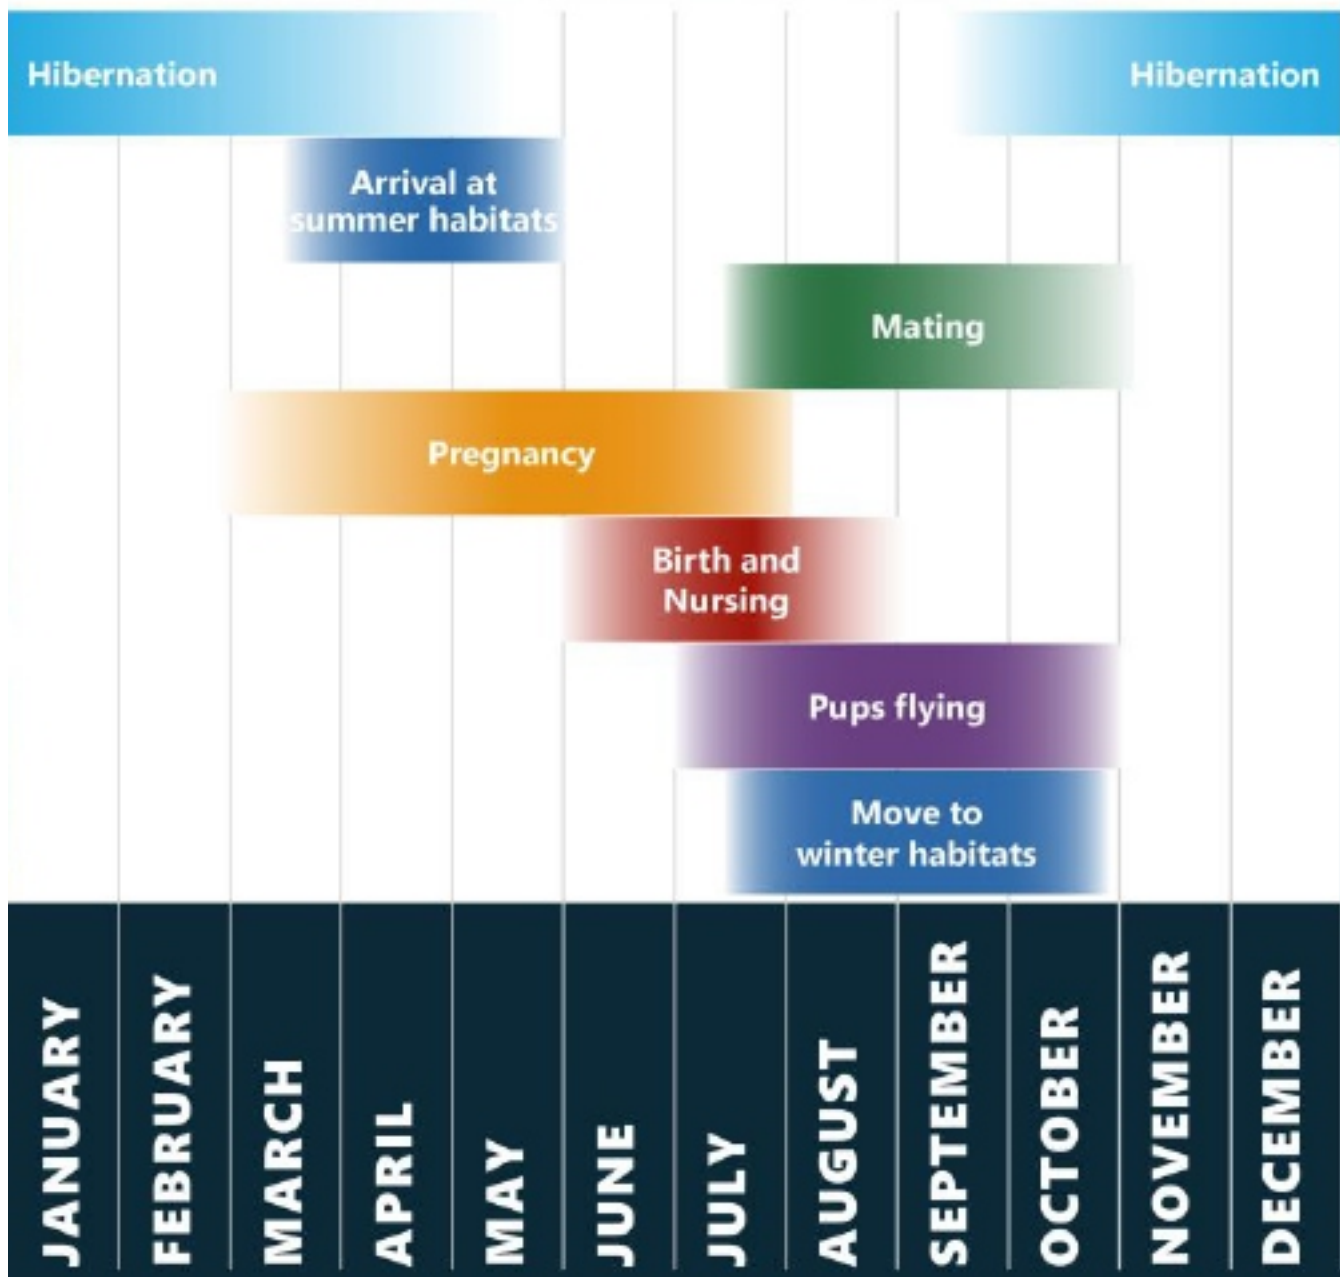

EXCLUSION GUIDELINES FOR BATS IN BC

